



Council of the
European Union

098074/EU XXV. GP
Eingelangt am 30/03/16

Brussels, 30 March 2016
(OR. en)

7383/16
ADD 1

ENER 97

COVER NOTE

From:	European Commission
date of receipt:	22 March 2016
To:	General Secretariat of the Council
No. Cion doc.:	D044617/02 - ANNEXES
Subject:	ANNEXES to the Commission Regulation (EU)... establishing a network code on requirements for grid connections of high voltage direct current systems and direct current-connected power park modules

Delegations will find attached document D044617/02 - ANNEXES.

Encl.: D044617/02 - ANNEXES



EUROPEAN
COMMISSION

Brussels, **XXX**
D044617/02
[...](2015) **XXX** draft

ANNEXES 1 to 8

ANNEXES

to the

Commission Regulation (EU)../..

**establishing a network code on requirements for grid connections of high voltage direct
current systems and direct current-connected power park modules**

ANNEXES

to the

Commission Regulation (EU)../..

establishing a network code on requirements for grid connections of high voltage direct current systems and direct current-connected power park modules

ANNEX I

Frequency ranges referred to in Article 11

Frequency range	Time period for operation
47.0 Hz – 47.5 Hz	60 seconds
47.5 Hz – 48.5 Hz	To be specified by each relevant TSO , but longer than established times for generation and demand according to [NC RfG] and [DCC] respectively, and longer than for DC-connected PPMs according to Article 39
48.5 Hz – 49.0 Hz	To be specified by each relevant TSO, but longer than established times for generation and demand according to [NC RfG] and [DCC] respectively, and longer than for DC-connected PPMs according to Article 39
49.0 Hz – 51.0 Hz	Unlimited
51.0 Hz – 51.5 Hz	To be specified by each relevant TSO, but longer than established times for generation and demand according to [NC RfG] and [DCC] respectively, and longer than for DC-connected PPMs according to Article 39
51.5 Hz – 52.0 Hz	To be specified by each relevant TSO , but longer than for DC-connected PPMs according to Article 39

Table 1: Minimum time periods an HVDC system shall be able to operate for different frequencies deviating from a nominal value without disconnecting from the network.

ANNEX II

Requirements applying to frequency sensitive mode, limited frequency sensitive mode overfrequency and limited frequency sensitive mode underfrequency

A. Frequency sensitive mode

1. When operating in frequency sensitive mode (FSM):
 - (a) the HVDC system shall be capable of responding to frequency deviations in each connected AC network by adjusting the active power transmission as indicated in Figure 1 and in accordance with the parameters specified by each TSO within the ranges shown in Table 2. This specification shall be subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;
 - (b) the adjustment of active power frequency response shall be limited by the minimum HVDC active power transmission capacity and maximum HVDC active power transmission capacity of the HVDC system (in each direction);

Figure 1

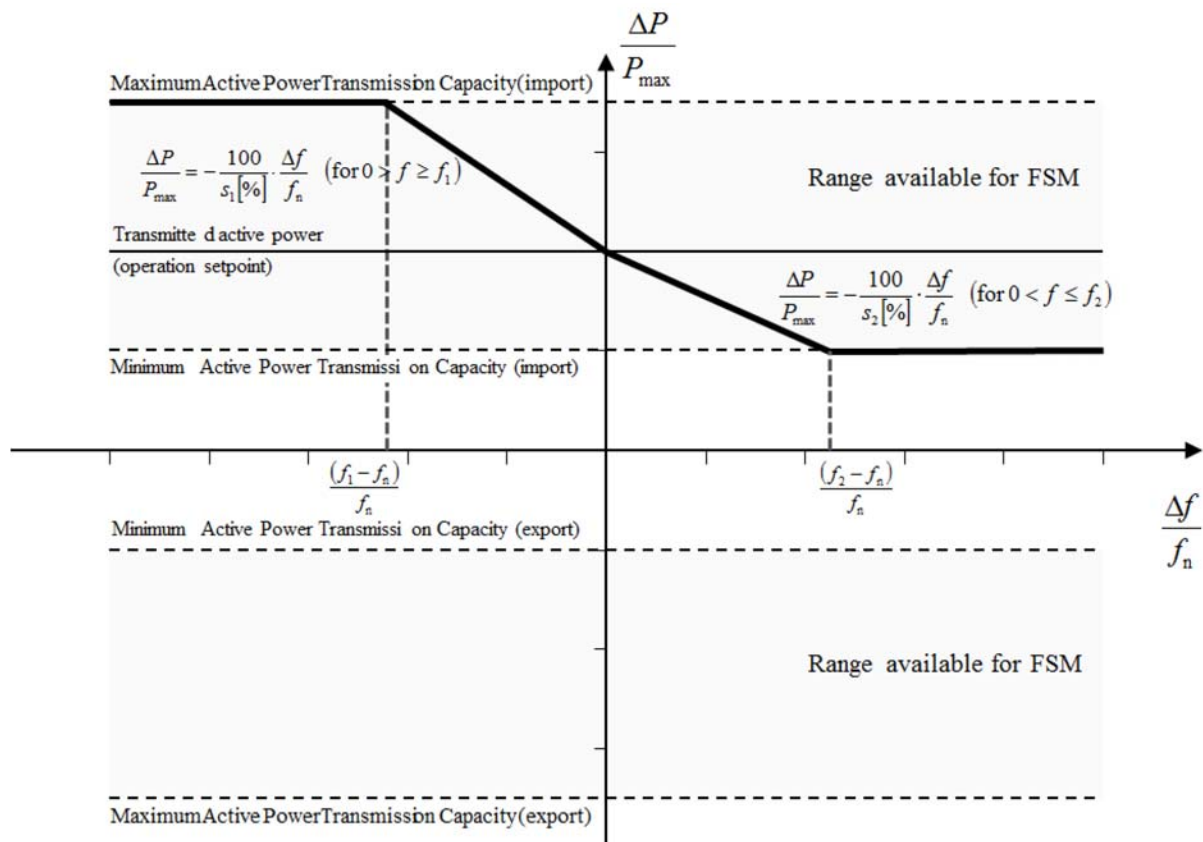


Figure 1: Active power frequency response capability of an HVDC system in FSM illustrating the case of zero deadband and insensitivity with a positive active power setpoint

(import mode). ΔP is the change in active power output from the HVDC system. f_n is the target frequency in the AC network where the FSM service is provided and Δf is the frequency deviation in the AC network where the FSM service is provided.

Parameters	Ranges
Frequency response deadband	0 – ± 500 mHz
Droop s_1 (upward regulation)	Minimum 0.1%
Droop s_2 (downward regulation)	Minimum 0.1%
Frequency response insensitivity	Maximum 30 mHz

Table 2: Parameters for active power frequency response in FSM

- (c) the HVDC system shall be capable, following an instruction from the relevant TSO, of adjusting the droops for upward and downward regulation, the frequency response deadband and the operational range of variation within the active power range available for FSM, set out in Figure 1 and more generally within the limits set by points (a) and (b). These values shall be subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;
- (d) as a result of a frequency step change, the HVDC system shall be capable of adjusting active power to the active power frequency response defined in Figure 1, in such a way that the response is:
 - (i) as fast as inherently technically feasible; and
 - (ii) at or above the solid line according to Figure 2 in accordance with the parameters specified by each relevant TSO within the ranges according to Table 3:
 - the HVDC system shall be able to adjust active power output ΔP up to the limit of the active power range requested by the relevant TSO in accordance with the times t_1 and t_2 according to the ranges in Table 3, where t_1 is the initial delay and t_2 is the time for full activation. The values of t_1 and t_2 shall be specified by the relevant TSO, subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;

- if the initial delay of activation is greater than 0.5 second, the HVDC system owner shall reasonably justify it to the relevant TSO.

Figure 2

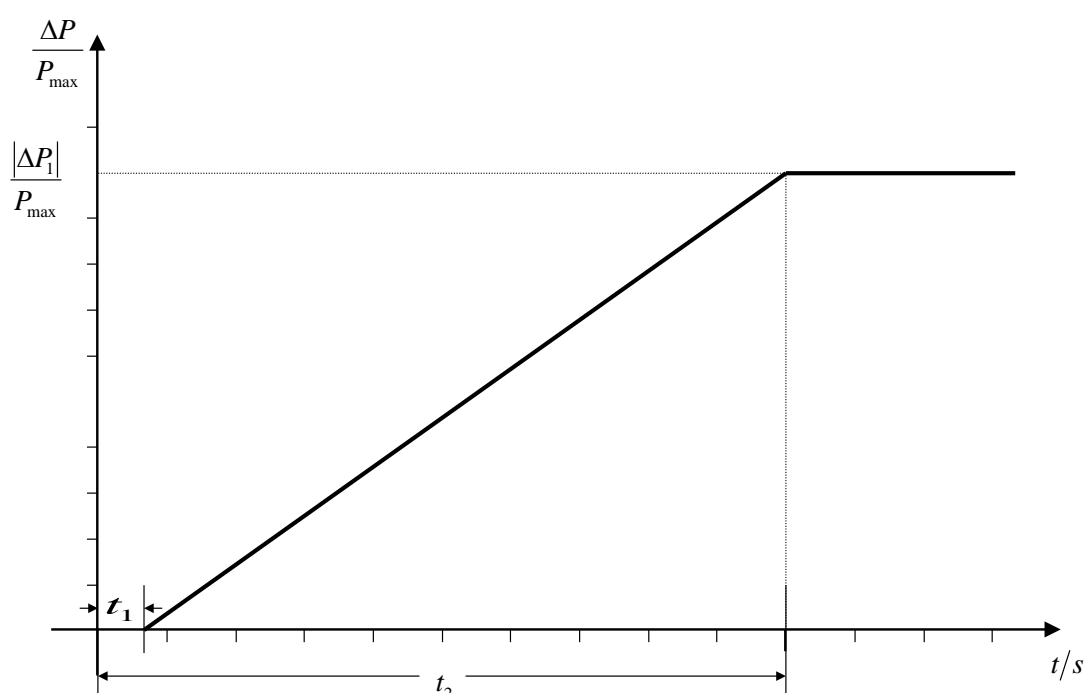


Figure 2: Active power frequency response capability of an HVDC system. ΔP is the change in active power triggered by the step change in frequency.

Parameters	Time
Maximum admissible initial delay t_1	0.5 seconds
Maximum admissible time for full activation t_2 , unless longer activation times are specified by the relevant TSO	30 seconds

Table 3: Parameters for full activation of active power frequency response resulting from frequency step change.

- (e) for HVDC systems linking various control areas or synchronous areas, in frequency sensitive mode operation the HVDC system shall be capable of adjusting full active power frequency response at any time and for a continuous time period;
- (f) as long as a frequency deviation continues active power control shall not have any adverse impact on the active power frequency response.

B. Limited frequency sensitive mode overfrequency

1. In addition to the requirements of Article 11 the following shall apply with regard to limited frequency sensitive mode – overfrequency (LFSM-O):
 - (a) the HVDC system shall be capable of adjusting active power frequency response to the AC network or networks, during both import and export, according to Figure 3 at a frequency threshold f_1 between and including 50.2 Hz and 50.5 Hz with a droop S_3 adjustable from 0.1 % upwards;
 - (b) the HVDC system shall be capable of adjusting active power down to its minimum HVDC active power transmission capacity;
 - (c) the HVDC system shall be capable of adjusting active power frequency response as fast as inherently technically feasible, with an initial delay and time for full activation determined by the relevant TSO and notified to the regulatory authority in accordance with the applicable national regulatory framework;
 - (d) the HVDC system shall be capable of stable operation during LFSM-O operation. When LFSM-O is active, hierarchy of control functions shall be organised in accordance with Article 35.
2. The frequency threshold and droop settings referred to in point (a) of paragraph 1 shall be determined by the relevant TSO and be notified to the regulatory authority in accordance with the applicable national regulatory framework.

Figure 3

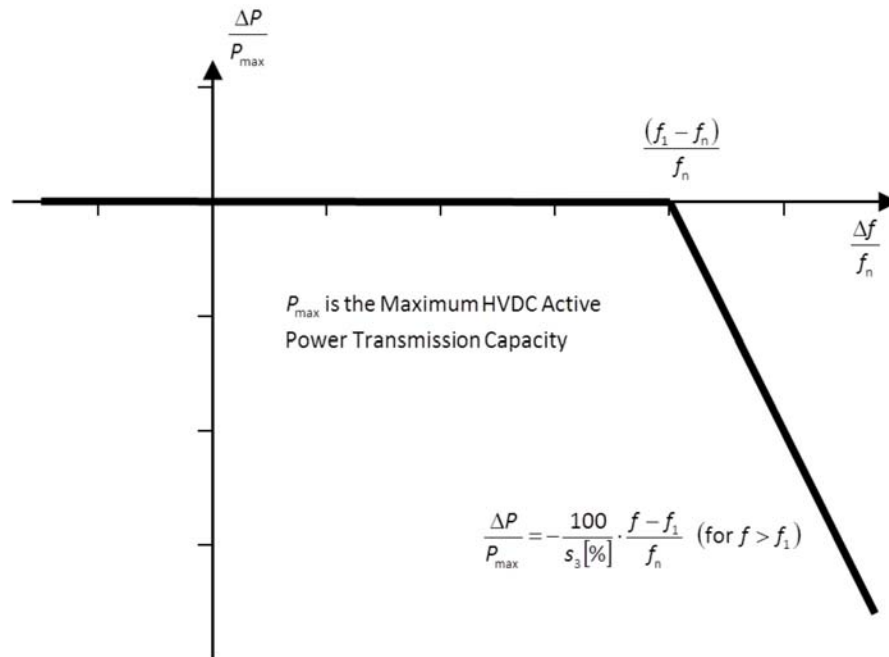


Figure 3: Active power frequency response capability of HVDC systems in LFSM-O. ΔP is the change in active power output from the HVDC system and, depending on the operational conditions, either a decrease of import power or an increase of export power. f_n is the nominal frequency of the AC network or networks the HVDC system is connected to and Δf is the frequency change in the AC network or networks the HVDC is connected to. At overfrequencies where f is above f_1 the HVDC system shall reduce active power according to the droop setting.

C. Limited frequency sensitive mode underfrequency

1. In addition to the requirements of Article 11, the following shall apply with regard to limited frequency sensitive mode – underfrequency (LFSM-U):
 - (a) the HVDC system shall be capable of adjusting active power frequency response to the AC network or networks, during both import and export, according to Figure 4 at a frequency threshold f_2 between and including 49.8 Hz and 49.5 Hz with a droop S_4 adjustable from 0.1 % upwards;
 - (b) in the LFSM-U mode the HVDC system shall be capable of adjusting active power up to its maximum HVDC active power transmission capacity;
 - (c) the active power frequency response shall be activated as fast as inherently technically feasible, with an initial delay and time for full activation determined by the relevant TSO and notified to regulatory authority in accordance with the applicable national regulatory framework;
 - (d) the HVDC system shall be capable of stable operation during LFSM-U operation. When LFSM-U is active, hierarchy of control functions shall be organised in accordance with Article 35.

2. The frequency threshold and droop settings referred to in point (a) of paragraph 1 shall be determined by the relevant TSO and be notified to the regulatory authority in accordance with the applicable national regulatory framework.

Figure 4

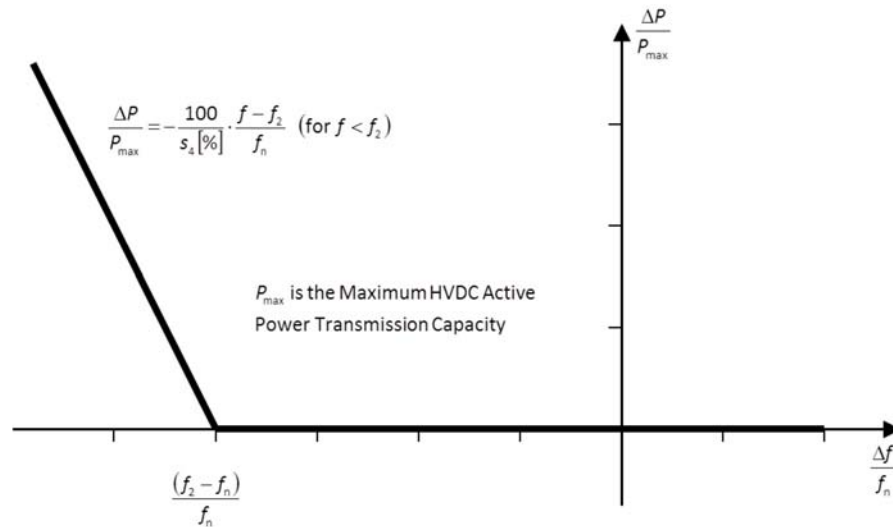


Figure 4: Active power frequency response capability of HVDC systems in LFSM-U. ΔP is the change in active power output from the HVDC system, depending on the operation condition a decrease of import power or an increase of export power. f_n is the nominal frequency in the AC network or networks the HVDC system is connected and Δf is the frequency change in the AC network or networks the HVDC is connected. At underfrequencies where f is below f_2 , the HVDC system has to increase active power output according to the droop s_4 .

ANNEX III

Voltage ranges referred to in Article 18

Synchronous Area	Voltage Range	Time period for operation
Continental Europe	0.85 pu – 1.118 pu	Unlimited
	1.118 pu – 1.15 pu	To be established by each relevant system operator, in coordination with the relevant TSO but not less than 20 minutes
Nordic	0.90 pu – 1.05 pu	Unlimited
	1.05 pu – 1.10 pu	60 minutes
Great Britain	0.90 pu – 1.10 pu	Unlimited
Ireland and Northern Ireland	0.90 pu – 1.118 pu	Unlimited
Baltic	0.85 pu – 1.118 pu	Unlimited
	1.118 pu – 1.15 pu	20 minutes

Table 4: Minimum time periods an HVDC system shall be capable of operating for voltages deviating from the reference 1 pu value at the connection points without disconnecting from the network. This table applies in case of pu voltage base values at or above 110 kV and up to (not including) 300 kV.

Synchronous Area	Voltage Range	Time period for operation
Continental Europe	0.85 pu – 1.05 pu	Unlimited
	1.05 pu – 1.0875 pu	To be specified by each TSO, but not less than 60 minutes
	1.0875 pu – 1.10 pu	60 minutes
Nordic	0.90 pu – 1.05 pu	Unlimited
	1.05 pu – 1.10 pu	To be specified by each TSO, but not more than 60 minutes
Great Britain	0.90 pu – 1.05 pu	Unlimited
	1.05 pu – 1.10 pu	15 minutes
Ireland and Northern Ireland	0.90 pu – 1.05 pu	Unlimited
Baltic	0.88 pu – 1.097 pu	Unlimited
	1.097 pu – 1.15 pu	20 minutes

Table 5: Minimum time periods an HVDC system shall be capable of operating for voltages deviating from the reference 1 pu value at the connection points without disconnecting from the network. This table applies in case of pu voltage base values from 300 kV to 400 kV (included).

Requirements for U-Q/Pmax-profile referred to in Article 20

Figure 5

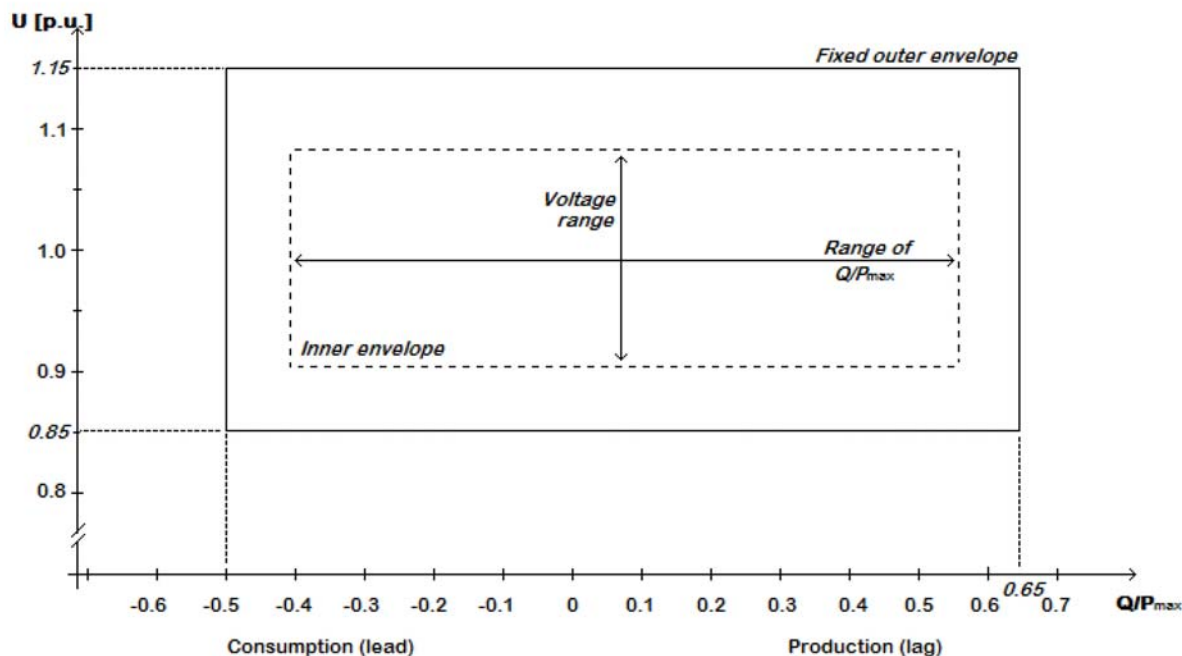


Figure 5: The diagram represents boundaries of a U-Q/Pmax-profile with U being the voltage at the connection points expressed by the ratio of its actual value to its reference 1 pu value in per unit, and Q/Pmax the ratio of the reactive power to the maximum HVDC active power transmission capacity. The position, size and shape of the inner envelope are indicative and shapes other than rectangular may be used within the inner envelope. For profile shapes other than rectangular, the voltage range represents the highest and lowest voltage points in this shape. Such a profile would not give rise to the full reactive power range being available across the range of steady-state voltages.

Synchronous Area	Maximum range of Q/Pmax	Maximum range of steady-state Voltage level in PU
Continental Europe	0.95	0.225
Nordic	0.95	0.15
Great Britain	0.95	0.225
Ireland and Northern Ireland	1.08	0.218
Baltic States	1.0	0.220

Table 6: Parameters for the Inner Envelope in the Figure.

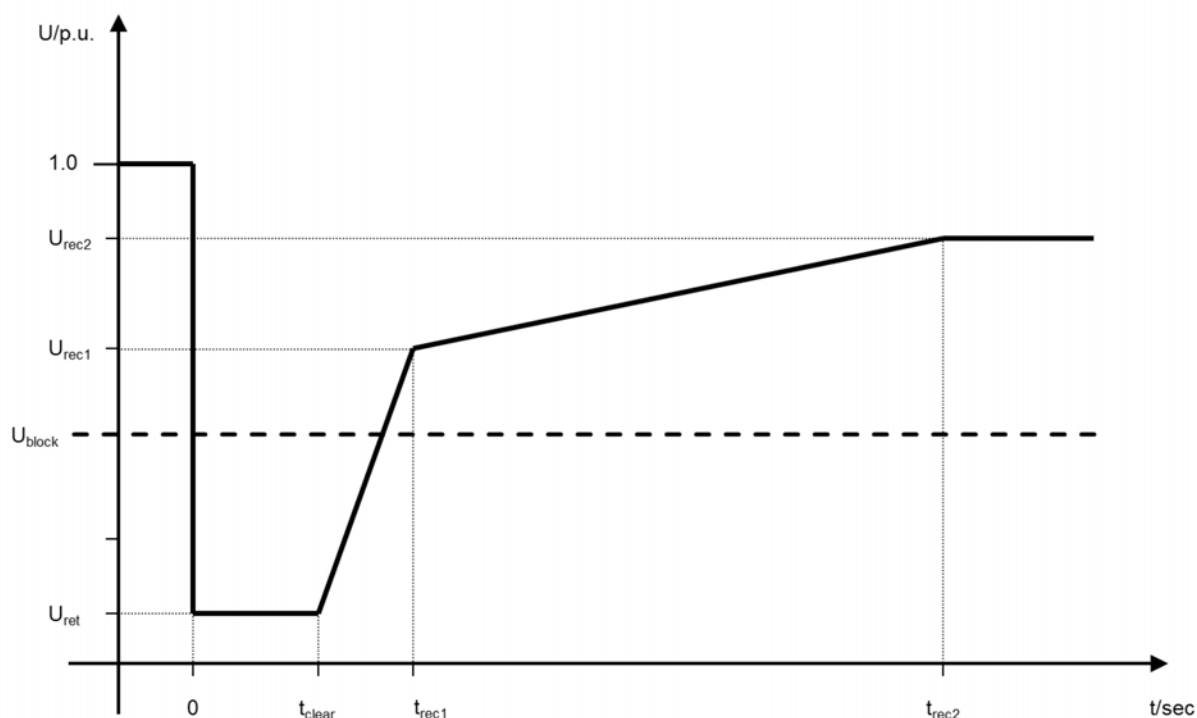
Figure 6

Figure 6: Fault-ride-through profile of an HVDC converter station. The diagram represents the lower limit of a voltage-against-time profile at the connection point, expressed by the ratio of its actual value and its reference 1 pu value in per unit before, during and after a fault. U_{ret} is the retained voltage at the connection point during a fault, t_{clear} is the instant when the fault has been cleared, U_{rec1} and t_{rec1} specify a point of lower limits of voltage recovery following fault clearance. U_{block} is the blocking voltage at the connection point. The time values referred to are measured from t_{fault} .

Voltage parameters [pu]		Time parameters [seconds]	
U_{ret}	0.00 – 0.30	t_{clear}	0.14-0.25
U_{rec1}	0.25-0.85	t_{rec1}	1.5 – 2.5
U_{rec2}	0.85-0.90	t_{rec2}	$T_{rec1} - 10.0$

Table 7: Parameters for Figure 6 for the fault-ride-through capability of an HVDC converter station.

ANNEX VI

Frequency ranges and time periods referred to in Article 39(2)(a)

Frequency range	Time period for operation
47.0 Hz – 47.5 Hz	20 seconds
47.5Hz – 49.0 Hz	90 minutes
49.0 Hz – 51.0 Hz	Unlimited
51.0 Hz – 51.5 Hz	90 minutes
51.5 Hz – 52.0 Hz	15 minutes

Table 8: Minimum time periods for the 50Hz nominal system for which a PPM shall be capable of operating for different frequencies deviating from a nominal value without disconnecting from the network.

ANNEX VII

Voltage ranges and time periods referred to in Article 40

Voltage Range	Time period for operation
0.85 pu – 0.90 pu	60 minutes
0.90 pu – 1.10 pu	Unlimited
1.10 pu – 1.118 pu	Unlimited, unless specified otherwise by the relevant system operator, in coordination with the relevant TSO.
1.118 pu – 1.15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO.

Table 9: Minimum time periods for which a DC-connected power park module shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 110 kV to (not including) 300 kV.

Voltage Range	Time period for operation
0.85 pu – 0.90 pu	60 minutes
0.90 pu – 1.05 pu	Unlimited
1.05 pu – 1.15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO. Various sub-ranges of voltage withstand capability can be specified.

Table 10: Minimum time periods for which a DC-connected power park module shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 300 kV to 400 kV (included).

Figure 7

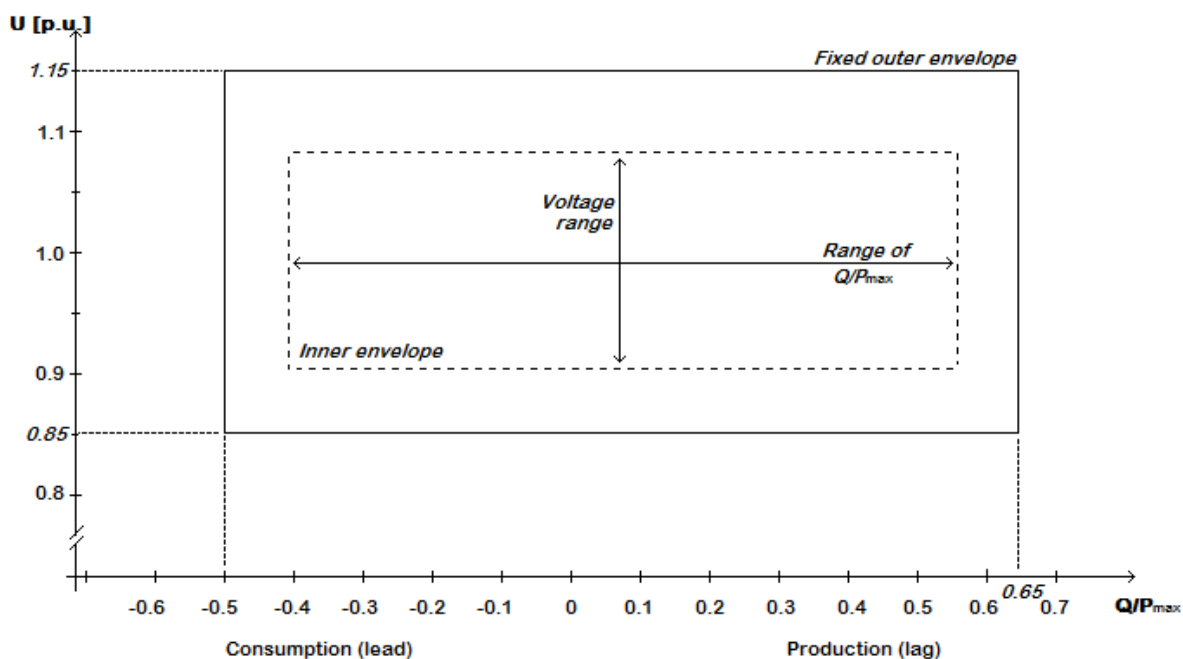


Figure 7: U-Q/Pmax-profile of a DC-connected power park module at the connection point. The diagram represents boundaries of a U-Q/Pmax-profile of the voltage at the connection point[s], expressed by the ratio of its actual value to its reference 1 pu value in per unit, against the ratio of the reactive power (Q) to the maximum capacity (Pmax). The position, size and shape of the inner envelope are indicative and other than rectangular may be used within the inner envelope. For profile shapes other than rectangular, the voltage range represents the highest and lowest voltage points. Such a profile would not give rise to the full reactive power range being available across the range of steady-state voltages.

Range of width of Q/Pmax profile	Range of steady-state Voltage level in pu
0 - 0.95	0.1 - 0.225

Table 11: Maximum and minimum range of both Q/Pmax and steady-state voltage for a DC-connected PPM

ANNEX VIII

Reactive power and voltage requirements referred to in Article 48

Voltage range	Time period for operation
0.85 pu – 0.90 pu	60 minutes
0.90 pu – 1.10 pu	Unlimited
1.10 pu – 1.12 pu	Unlimited, unless specified otherwise by the relevant system operator, in coordination with the relevant TSO.
1.12 pu – 1.15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO.

Table 12: Minimum time periods for which a remote-end HVDC converter station shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 110 kV to (not including) 300 kV.

Voltage range	Time period for operation
0.85 pu – 0.90 pu	60 minutes
0.90 pu – 1.05 pu	Unlimited
1.05 pu – 1.15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO. Various sub-ranges of voltage withstand capability may be specified.

Table 13: Minimum time periods for which a remote-end HVDC converter station shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 300 kV to 400 kV (included).

Maximum range of Q/Pmax	Maximum range of steady-state voltage level in PU
0.95	0.225

Table 14: Maximum range of both Q/Pmax and steady-state voltage for a remote-end HVDC converter station.